

N 5.52%

1GW 3GW  
 N TOPCon  
 N P  
 7 15 8  
 N TOPCon PERC  
 5.52%

Tiger Neo N  
 2023 7 15 -8  
 N P  
 N TOPCon  
 5.52%

N29°56'50.75" E100°37'1.94"  
 4000m-4600m  
 6434.8MJ/m<sup>2</sup>

N TOPCon 4600m  
 N TOPCon P  
 5.52%

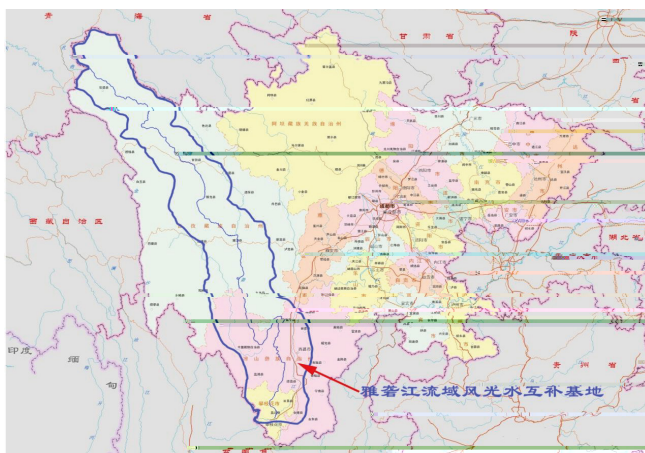


图1: 项目位置

Tiger Neo

N TOPCon  
 1%  
 -0.29% / P  
 2% N

74  
 149 163  
 26° ± 45° 10.5  
 1.8 196kW  
 26  
 1.21 1.15  
 N TOPCon P PERC

1%-1.5% N 15%-20%  
 10 80% P  
 1% N 0.4% N TOPCon  
 IEC61215 UV+TC+HF  
 0.16% PVEL PQP  
 DH2000 N TOPCon  
 0.55% N TOPCon

	kWh	kWh/kW	
N 型 570Wp 双面	532046.15	137.55	5.52%
P 型 545Wp 双面	471000.17	130.35	

表1:N型和P型组件发电量及增益对比

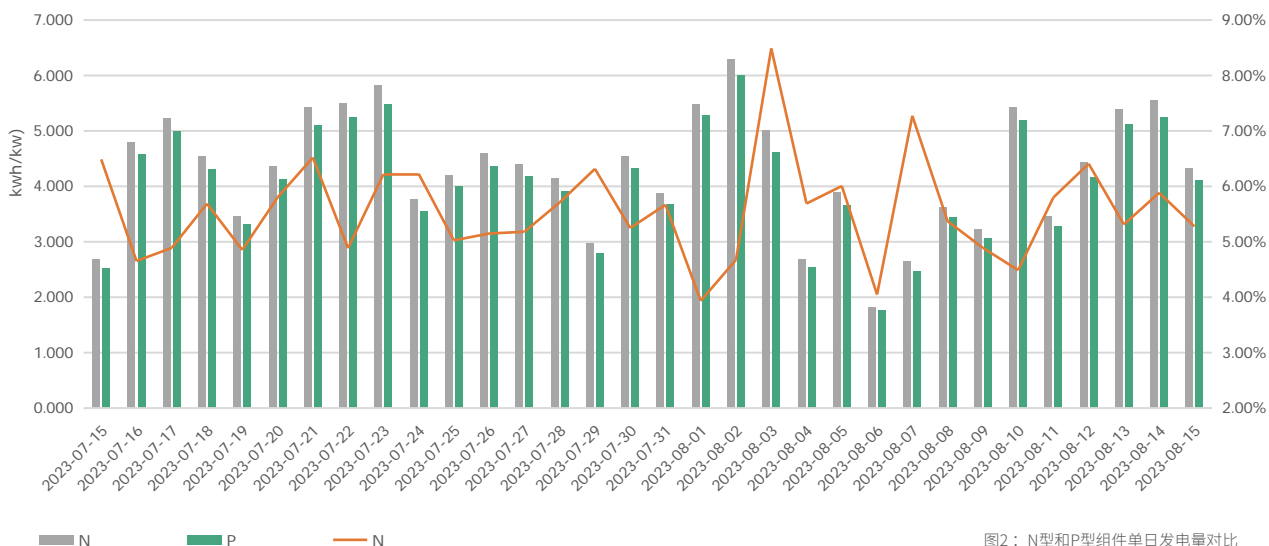


图2: N型和P型组件单日发电量对比